

# Southern Vermont Regional Airport Clarendon, VT PFAS Sampling Locations


## Key to Map

- o - Water Supply Sample Location
- - non-detect sample location
- - detections below DWHA
- - detections above DWHA

PFAS - Per- and Polyfluoroalkyl Substances  
 PFOA - Perfluorooctanic Acid  
 PFOS - Perfluorooctanesulfonic Acid  
 PFHpA - Perfluoroheptanoic Acid  
 PFHxA - Perfluorohexanoic Acid  
 PFHxS - Perfluorohexanesulfonic Acid  
 PFBS - Perfluorobutanesulfonic Acid  
 PFNA - Perfluorononanoic Acid

ND - Not Detected above detection limits  
 DWHA - Vermont Drinking Water Health Advisory  
 ppt - parts per trillion

**Note:** 1 part per trillion = 1 nanogram per liter (ng/l)

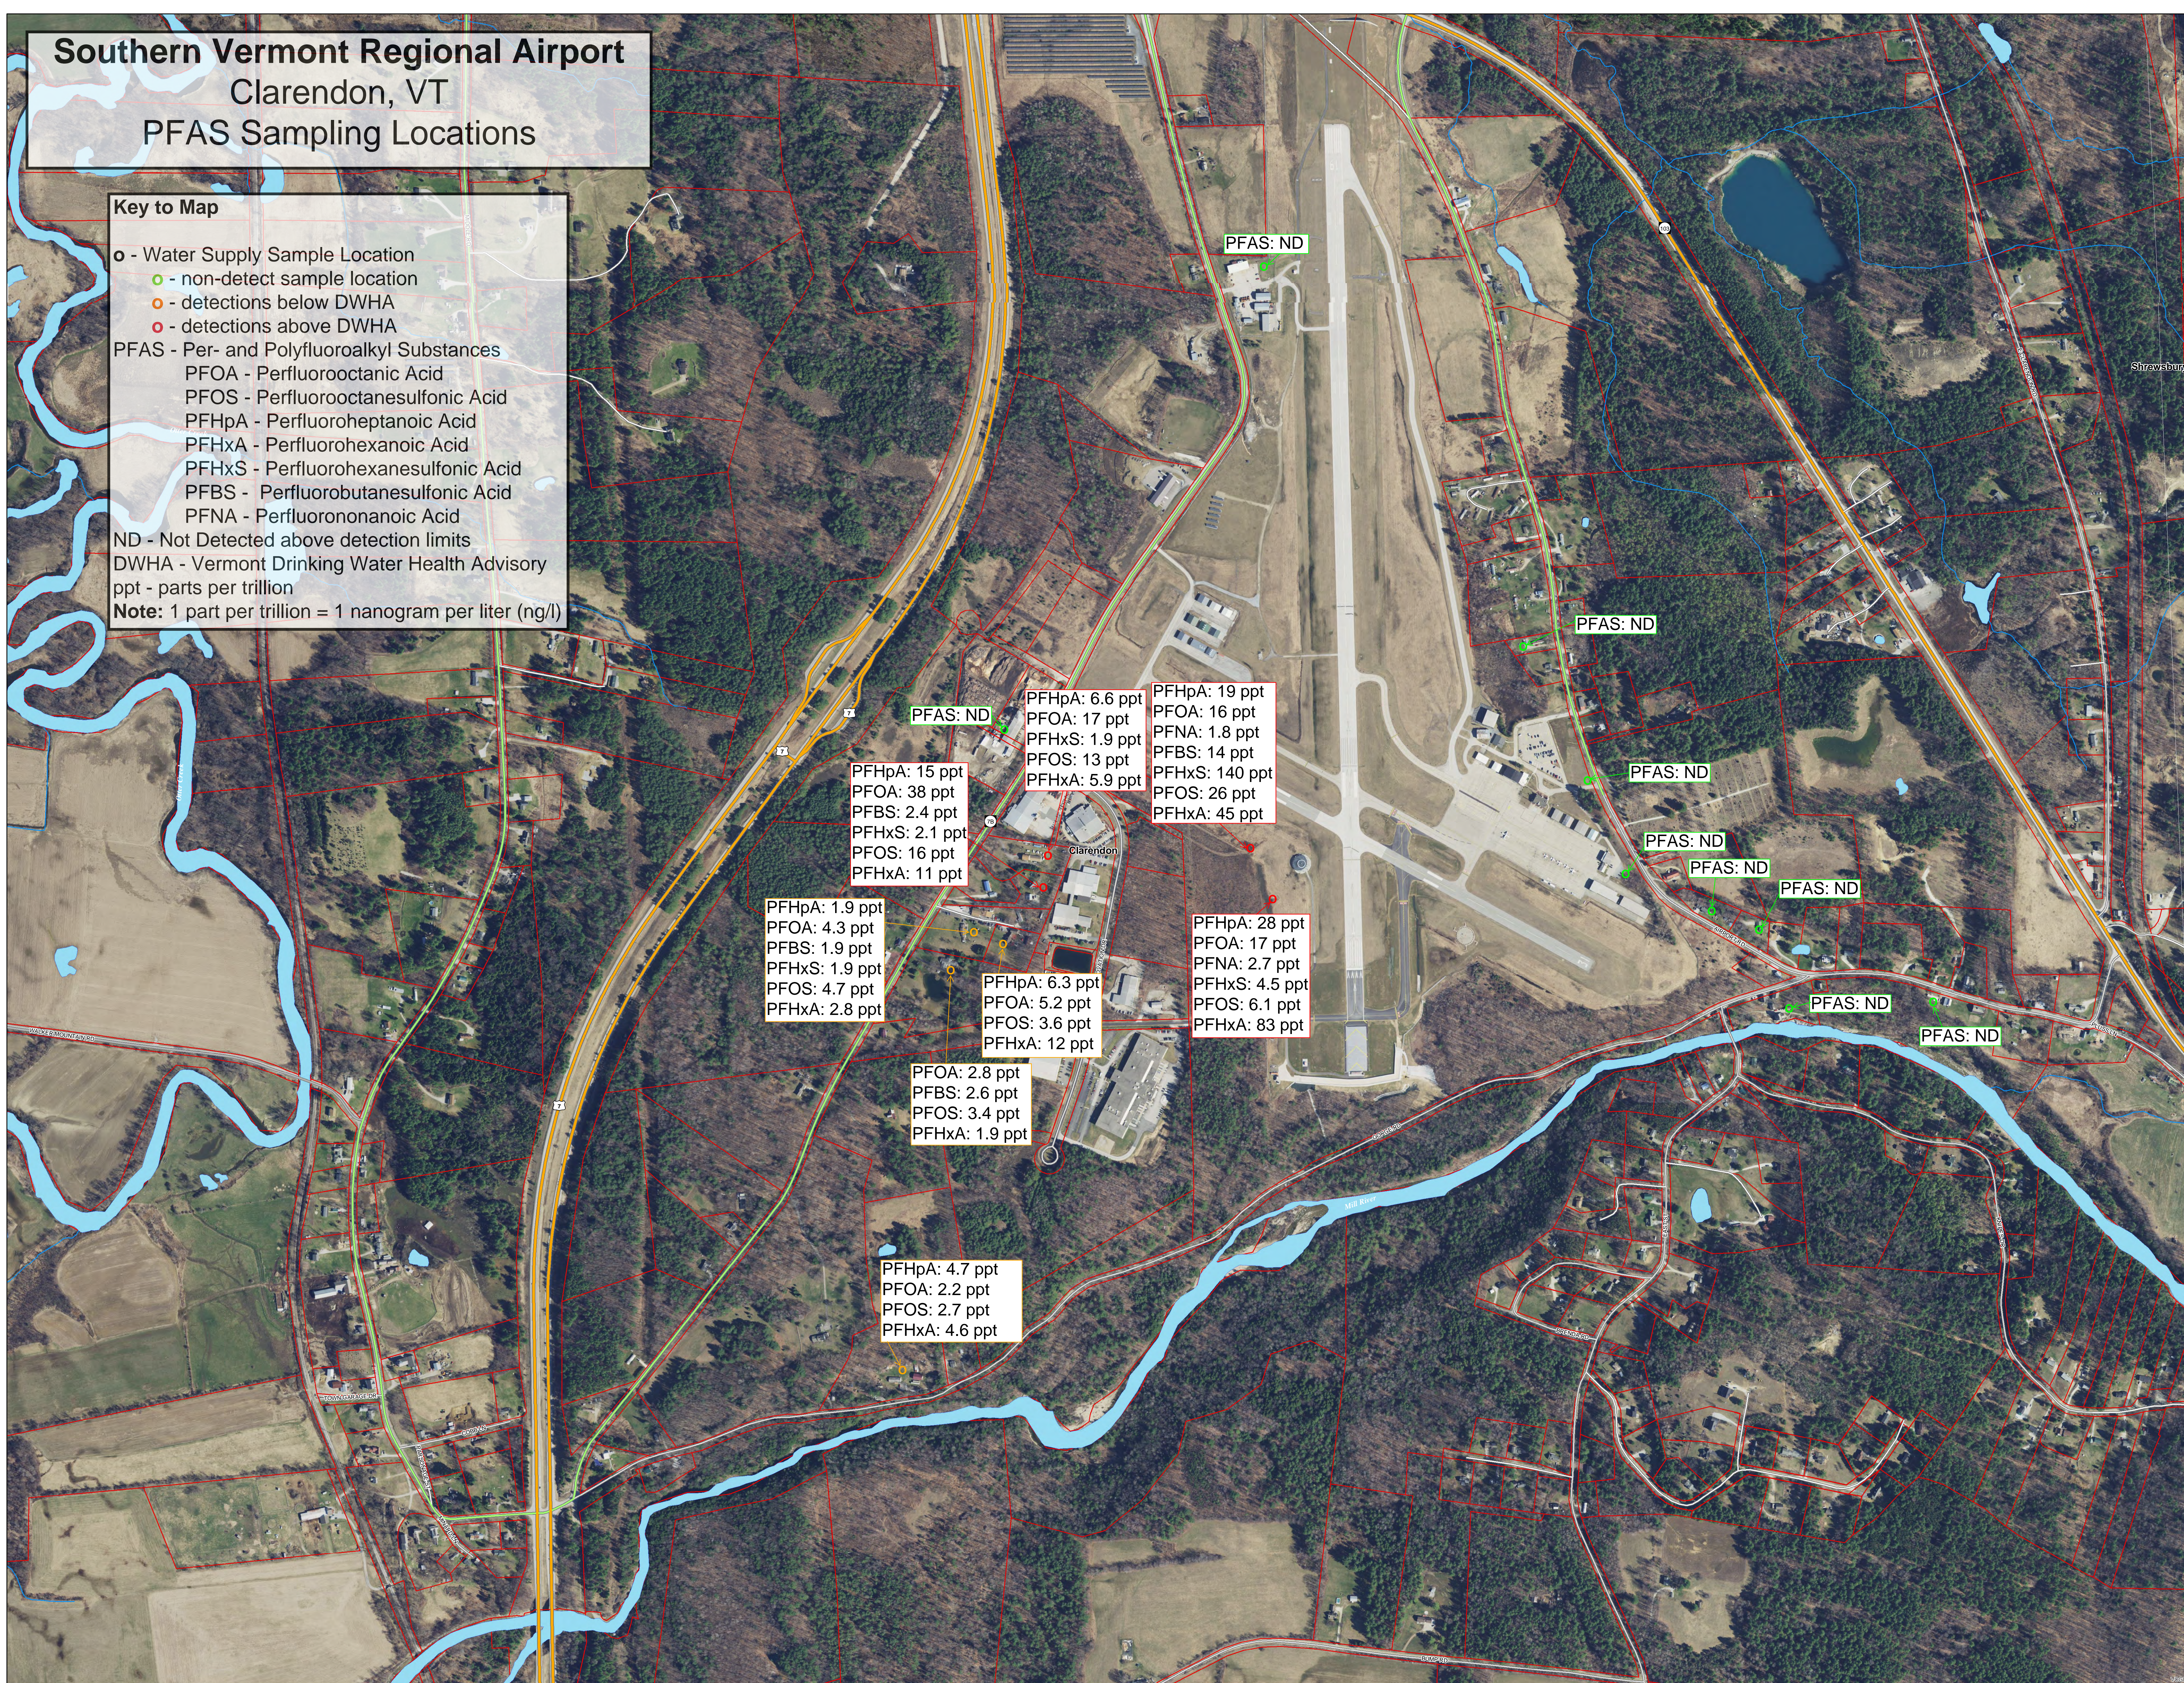

PFAS: ND

PFAS: ND

PFAS: ND

PFHpA: 15 ppt  
 PFOA: 38 ppt  
 PFBS: 2.4 ppt  
 PFHxS: 2.1 ppt  
 PFOS: 16 ppt  
 PFHxA: 11 ppt

PFHpA: 6.6 ppt  
 PFOA: 17 ppt  
 PFHxS: 1.9 ppt  
 PFOS: 13 ppt  
 PFHxA: 5.9 ppt

PFHpA: 19 ppt  
 PFOA: 16 ppt  
 PFNA: 1.8 ppt  
 PFBS: 14 ppt  
 PFHxS: 140 ppt  
 PFOS: 26 ppt  
 PFHxA: 45 ppt

PFAS: ND

PFAS: ND

PFAS: ND

PFAS: ND

PFHpA: 1.9 ppt  
 PFOA: 4.3 ppt  
 PFBS: 1.9 ppt  
 PFHxS: 1.9 ppt  
 PFOS: 4.7 ppt  
 PFHxA: 2.8 ppt

PFHpA: 6.3 ppt  
 PFOA: 5.2 ppt  
 PFOS: 3.6 ppt  
 PFHxA: 12 ppt

PFHpA: 28 ppt  
 PFOA: 17 ppt  
 PFNA: 2.7 ppt  
 PFHxS: 4.5 ppt  
 PFOS: 6.1 ppt  
 PFHxA: 83 ppt

PFOA: 2.8 ppt  
 PFBS: 2.6 ppt  
 PFOS: 3.4 ppt  
 PFHxA: 1.9 ppt

PFHpA: 4.7 ppt  
 PFOA: 2.2 ppt  
 PFOS: 2.7 ppt  
 PFHxA: 4.6 ppt

PFAS: ND

PFAS: ND